

Select All delete
Supply Air for the LP System
changed but the HP stayed
the same

System Browser - system testing 2.rvt

View: Systems Mechanical


Systems	Flow	Size	Space Name	Space Number	Loss Coefficient
[-] Unassigned (0 items)					
[-] Mechanical (2 systems)					
[-] HP - Supply Air					
[-] HP5A 1		2700 CFM			
[-] LP - Supply Air					
[-] SA 40		2400 CFM			

1/8" = 1'-0"

click to select, TAB for alternates, CTRL adds, SHIFT unselects.

0.0


Main Model

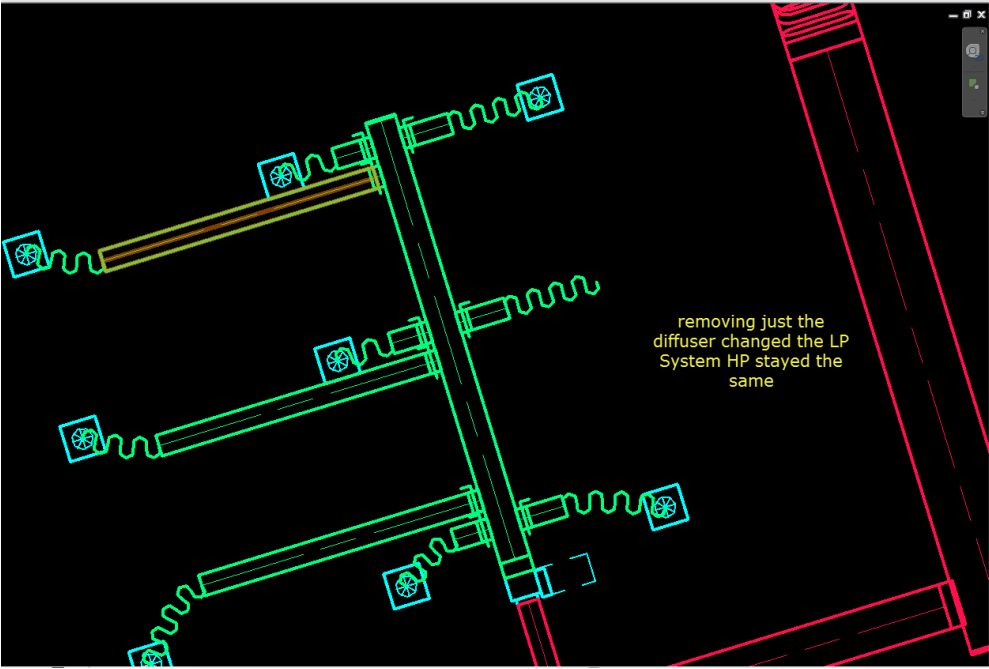

System Browser - system testing 2.rvt

View: Systems Mechanical

Systems	Flow	Size	Space Name	Space Number	Loss Coefficient
Unassigned (0 items)					
Mechanical (2 systems)					
HP - Supply Air					
WPSA 1		2700 CFM			
LP - Supply Air					
SA 40		2400 CFM			

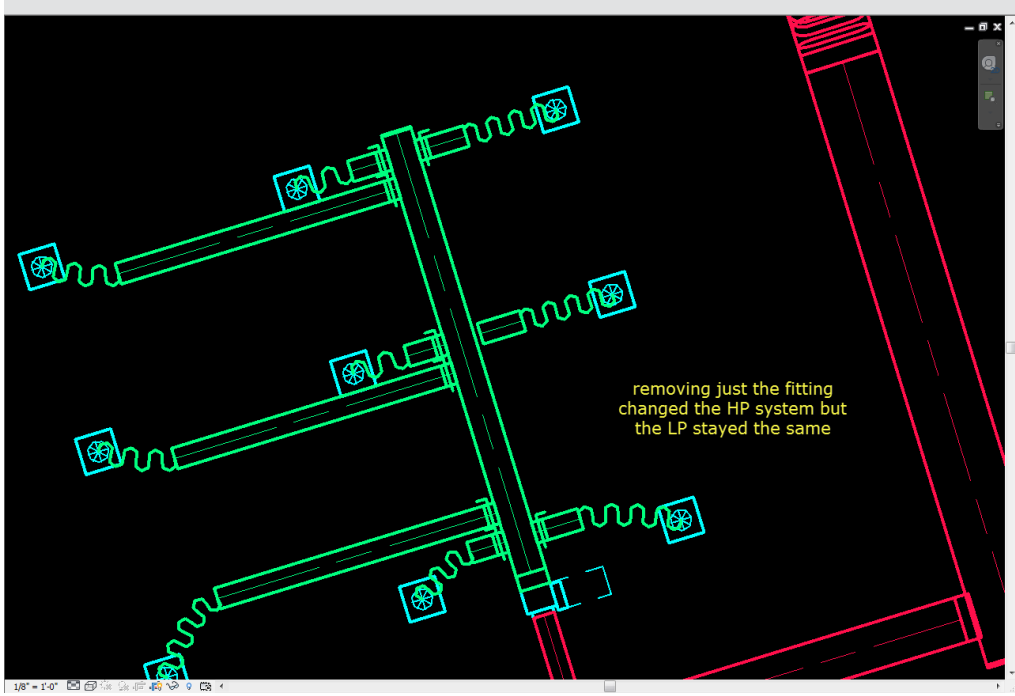

System Browser - system testing 2.rvt

View: Systems Mechanical

Systems	Flow	Size	Space Name	Space Number	Loss Coefficient
Unassigned (0 items)					
Mechanical (2 systems)					
HP - Supply Air					
HPSA 1		2400 CFM			
LP - Supply Air					
SA 40		2700 CFM			

