



- NOTES:
1. ALL D.I. PIPE AND FITTINGS TO BE SHOP PRIMED AND FIELD FINISHED PER SECTION 09800 OF THE SPECIFICATIONS.
 2. ALL WALL PENETRATIONS TO BE SEALED WITH "LIME-SEAL" PIPE PENETRATION SEALS AND GROUTED EACH SIDE OF WALL.
 3. PLUG VALVE ACTUATORS SHOWN AS 1/4 TURN VALVES, ALL SHOULD HAVE GEAR DRIVES.

REV	DATE	DESCRIPTION	BY
1	12/18/2014	DEQ SUBMITTAL SET	KRU

DOWL HKM
 Bozeman, Montana 59715
 www.dowlhkm.com
 2090 Stadium Drive
 406-586-8654

SECTION 3A

SECTION 3B

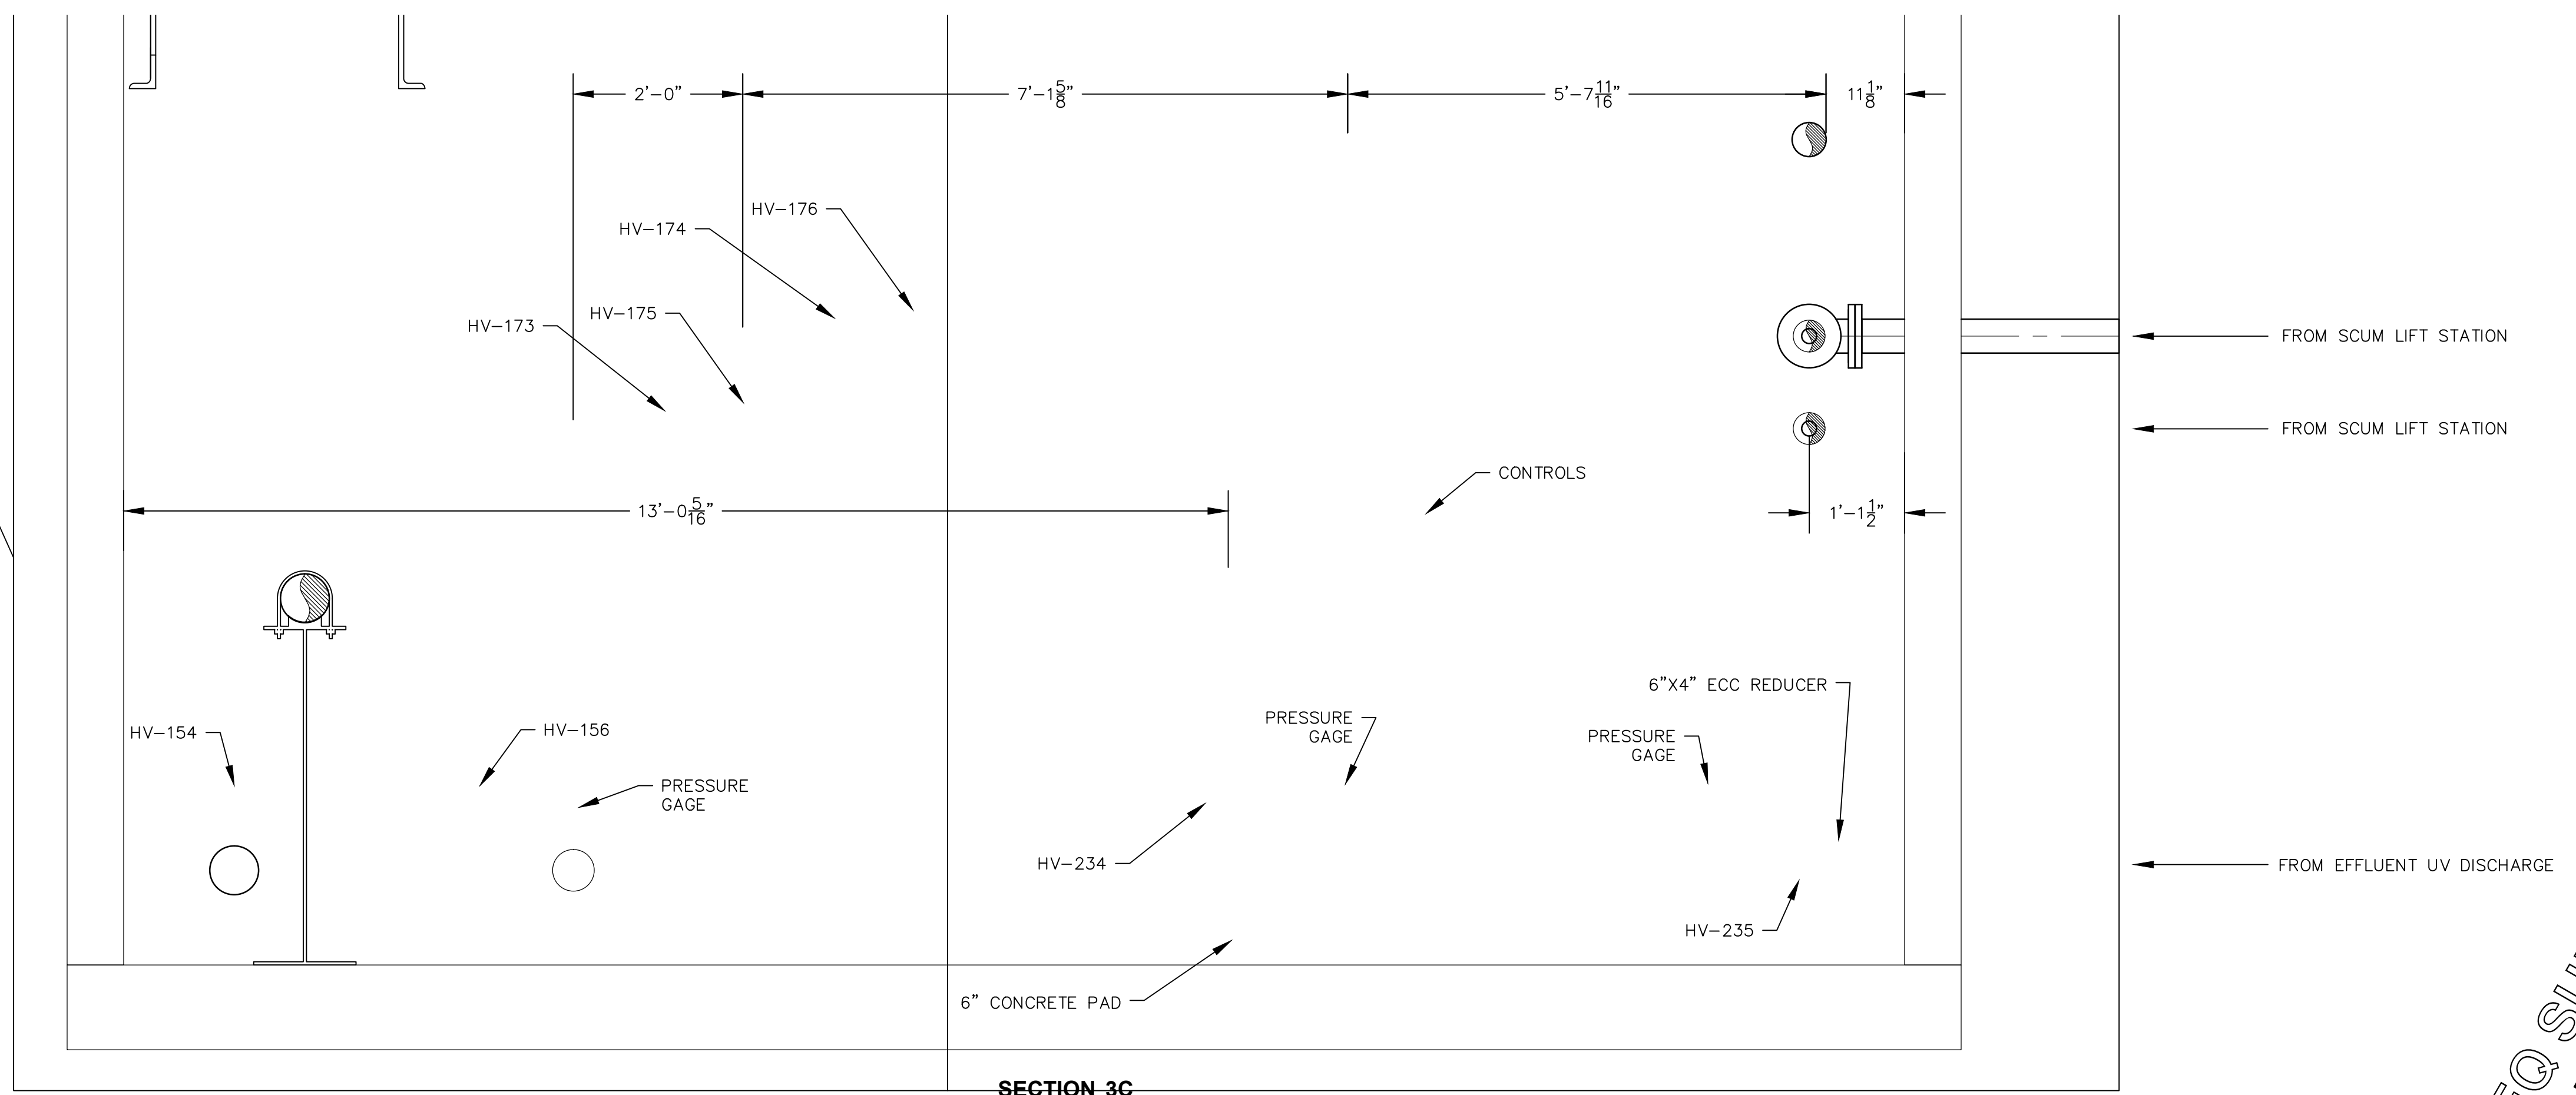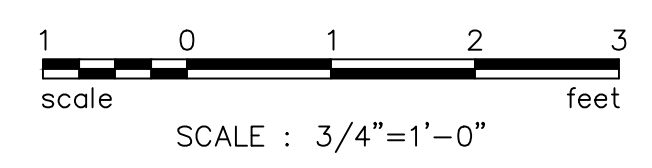

SECTION 3C

**DEQ SUBMITTAL
NOT FOR CONSTRUCTION**

CITY OF CHOTEAU - WATER RESOURCE RECOVERY FACILITY
 CHOTEAU, MONTANA

PROJECT 4528.11360.01
 DATE 12/18/2014

©DOWLHKM 2014
 SHEET
MP07

S25 & S36 T24N R5W
 TETON COUNTY, MONTANA