

### Clash Detective

FP vs P ⚠

Last Run: Thursday, June 14, 2012 4:41:25 PM  
Clashes - Total: 116 (Open: 111 Closed: 5)

Name	Status	Clashes	New	Acti...	Revi...	Ap...	Resolved
FP vs M	Old	2	0	0	0	0	2
FP vs P	Old	116	0	111	0	0	5
FP vs S	Old	11	4	3	0	0	4
HEADROOM vs M, F	Old	3	0	2	0	0	1
M vs P	Old	4	0	4	0	0	0

Rules Select Results Report

New Group Assign Re-run Test

Name	Status	Level	Grid Intersection	Found	Appro...
P-STORM DR...	Resolved	Roof Deck (-54)	B(-1)-6(-4)	16:11:24 12...	
P-SANITARY...	Active	Roof Deck (-54)	B(2)-4(-4)	*VARIES*	
Clash84	Resolved	Roof Deck (-54)	C(-6)-4(-1)	17:03:19 12...	
Clash77	Active	Roof Deck (-57)	E.2(7)-T-5(-2)	16:11:24 12...	
Clash69	Active	Roof Deck (-54)	C(-4)-8(2)	16:11:24 12...	
Clash58	Resolved	Roof Deck (-54)	C(-5)-4(-1)	16:11:24 12...	
Clash55	Active	Roof Deck (-58)	D(-3)-3.2(6)	16:11:24 12...	
Clash44	Active	Roof Deck (-57)	E.1(-1)-1-5(-3)	16:11:24 12...	
Clash42	Active	Roof Deck (-58)	D(-3)-3.2(8)	16:11:24 12...	
Clash31	Active	Roof Deck (-54)	B(-2)-4(-4)	16:11:24 12...	
Clash28	Active	Roof Deck (-58)	E.1(-1)-T-1(6)	16:11:24 12...	
Clash21	Active	Roof Deck (-54)	B(2)-8(1)	16:11:24 12...	
Clash20	Active	Roof Deck (-54)	B(-1)-7(-3)	16:11:24 12...	
Clash6	Active	Roof Deck (-54)	B(-1)-8(2)	16:11:24 12...	
Clash3	Active	Roof Deck (-54)	B(2)-4(-4)	16:11:24 12...	
Clash2	Resolved	Roof Deck (-56)	B(2)-3.2(6)	16:11:24 12...	
P-GAS	Resolved	Roof Deck (-58)	E.1(-7)-3.2(1)	*VARIES*	
Clash83	Resolved	Roof Deck (-54)	E.1(-7)-6(-5)	17:03:19 12...	
Clash78	Resolved	Roof Deck (-54)	E.1(-7)-6(-5)	16:11:24 12...	
Clash66	Resolved	Roof Deck (-54)	E.1(-7)-6(-5)	16:11:24 12...	
Clash43	Resolved	Roof Deck (-58)	E.1(-7)-3.2(1)	16:11:24 12...	
P-DOMESTIC...	Resolved	Roof Deck (-55)	D(-1)-4(-3)	16:11:24 12...	
Clash61	Resolved	Roof Deck (-55)	D(-1)-4.2(7)	16:11:24 12...	
Clash51	Resolved	Roof Deck (-55)	D(-1)-4(-3)	16:11:24 12...	
P-DOMESTIC...	Resolved	Roof Deck (-58)	A.2(-1)-3.2(6)	16:11:24 12...	
Clash75	Resolved	Roof Deck (-54)	E.2(7)-T-2(6)	16:11:24 12...	
Clash74	Resolved	Roof Deck (-54)	E.2(7)-6(-6)	16:11:24 12...	
Clash67	Resolved	Roof Deck (-58)	A.2(-1)-3.1(-8)	16:11:24 12...	

Items


Item Name: Fire\_Protection-Branches  
Item Type: 3D Solid

Item Name: P\_Sanitary\_Sewer  
Item Type: PRCD\_PIPE

FP-B1.nwd  
Fire\_Protection-Branches

P-B1.dwg  
P\_Sanitary\_Sewer

Hinhlint Group SwitchBack Select Hinhlint Group SwitchBack Select

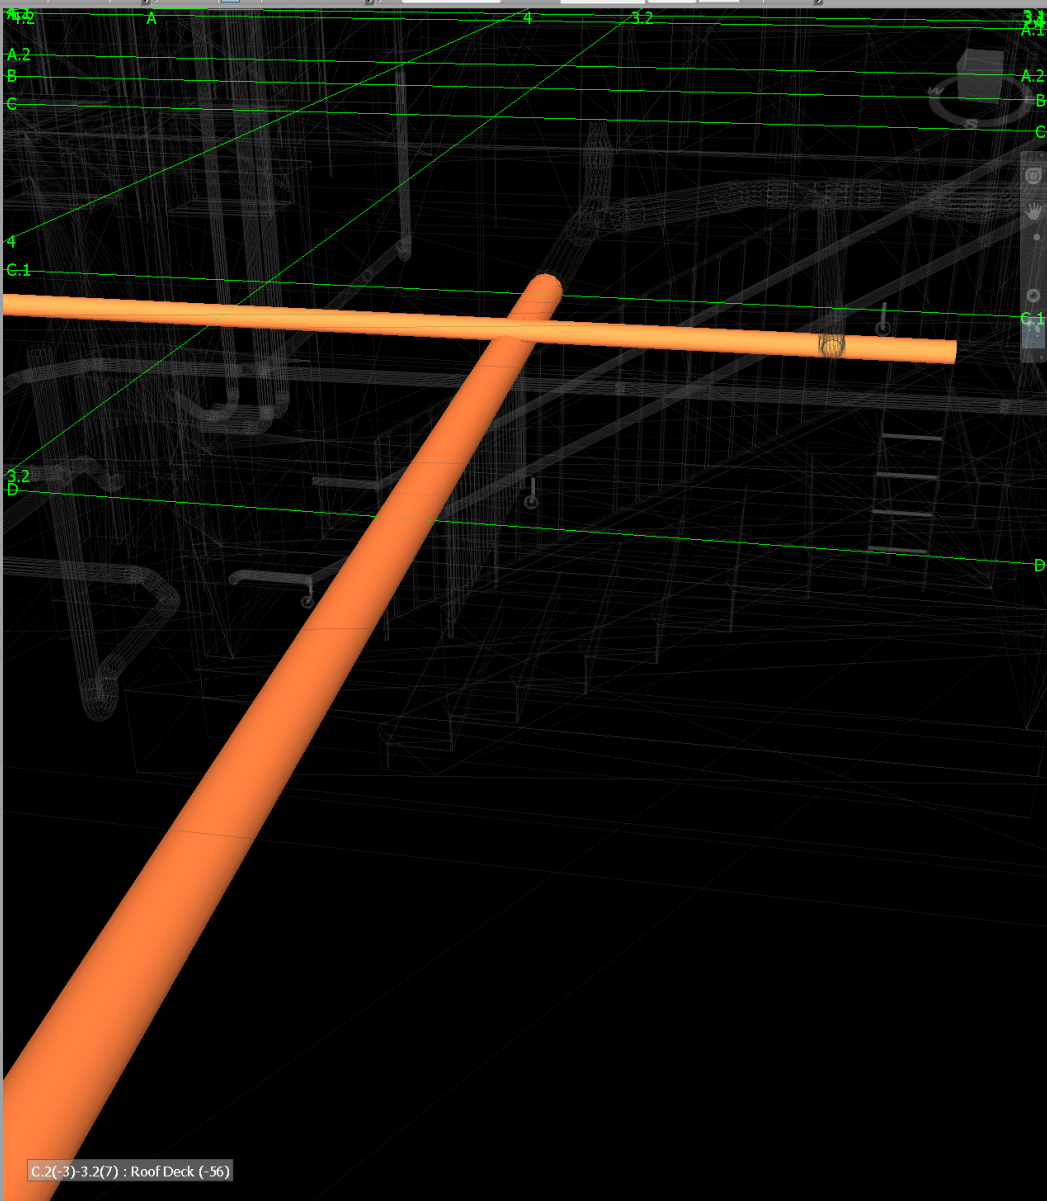

### Saved Viewports

- FP vs M
- FP vs P
- FP vs S
- M vs P
- M vs P subslab
- M vs S
- P subslab vs S
- P vs S
- TOP
- ELEC 004 ROOM - PIPES CANT BE OVER ELEC RM
- MECH - 7'-0" HEADROOM

C.2(-3)-3.2(7) : Roof Deck (-56)