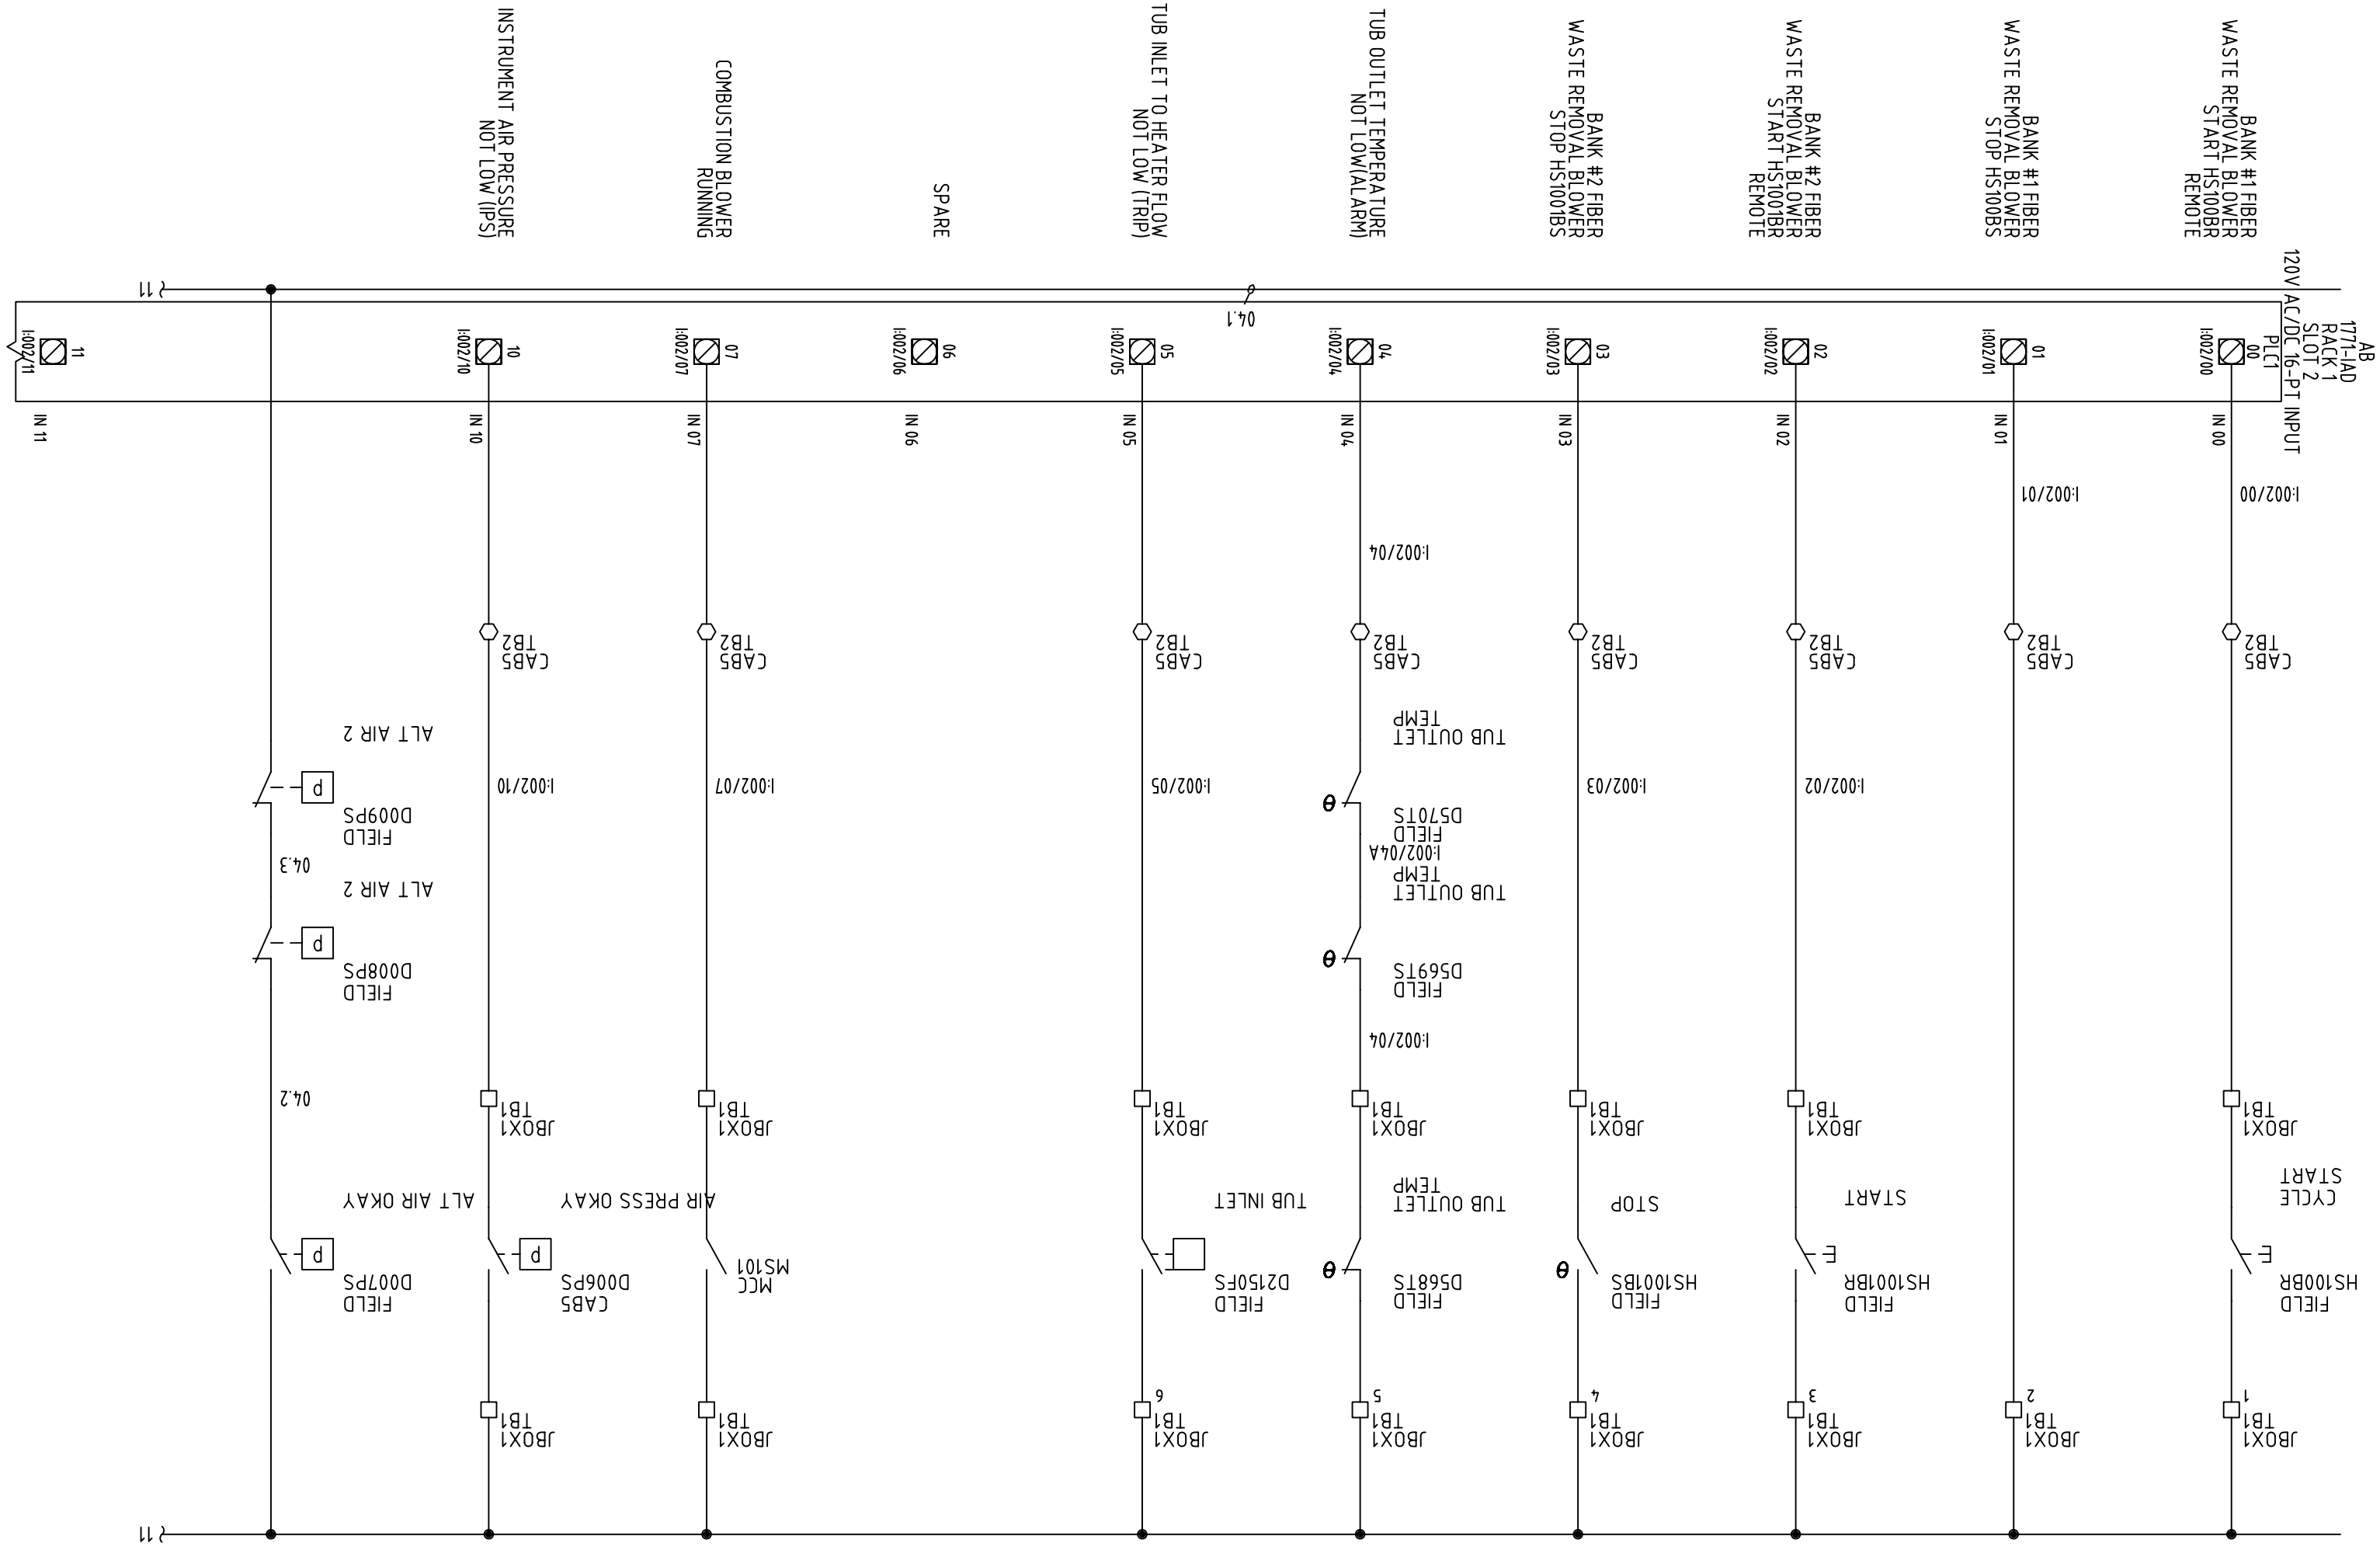
AB
1771-IAD
RACK 1
SLOT 2
AC/DC 16-PT INPUT
PLC1
120V
BANK #1 FIBER WASTE REMOVAL BLOWER START HS100BR REMOTE
BANK #1 FIBER WASTE REMOVAL BLOWER STOP HS100BS
BANK #2 FIBER WASTE REMOVAL BLOWER START HS100BR REMOTE
BANK #2 FIBER WASTE REMOVAL BLOWER STOP HS100BS
TUB OUTLET TEMPERATURE NOT LOW(ALARM)
TUB INLET TO HEATER FLOW NOT LOW (TRIP)
SPARE
COMBUSTION BLOWER RUNNING
INSTRUMENT AIR PRESSURE NOT LOW (IPS)
00 I:002/00 IN 00
01 I:002/01 IN 01
02 I:002/02 IN 02
03 I:002/03 IN 03
04 I:002/04 IN 04
05 I:002/05 IN 05
06 I:002/06 IN 06
07 I:002/07 IN 07
10 I:002/10 IN 10
11 I:002/11 IN 11
04.1
11
CABS TB2
TUB OUTLET TEMP
ALT AIR 2
JBOX1 TB1
FIELD HS100BR
CYCLE START
FIELD HS100BR
START
FIELD HS100BS
STOP
FIELD D568TS
TUB OUTLET TEMP
FIELD D215OFS
TUB INLET
MCC MS101
AIR PRESS OKAY
CABS D006PS
ALT AIR OKAY
FIELD D007PS
FIELD D569TS
TUB OUTLET TEMP
I:002/04A
FIELD D570TS
FIELD D008PS
ALT AIR 2
04.3
FIELD D009PS
04.2
11