

MATERIALS:

A. CONCRETE UNITS:

1. EXTERIOR DIMENSIONS FOR SHALL BE X X X
2. UNITS SHALL BE INTERLOCKED WITH PVC INSERT. THE INSERTS WILL BE INSTALLED IN THE INTENDED SLOTS OF THE UNIT. TO ACHIEVE THE DESIRED SLOPE
3. CORES SHALL BE FILLED WITH CRUSHED STONE

B. INTERLOCKING INSERTS:

1. INSERTS SHALL BE PVC.
2. CLIPS SHALL BE INSTALLED PER MANUFACTURES REQUIREMENTS.

C. BASE MATERIAL

1. AN UNREINFORCED, LEAN CONCRETE FOOTING MAY BE SUBSTITUTED FOR THE GRANULAR BASE.

D. DRAINAGE FILL


1. DRAINAGE FILL SHALL BE CRUSHED STONE. THE FILL SHALL HAVE A MAXIMUM SIZE OF 3/4" AND SHALL NOT HAVE A FINE CONTENT(PASSES #200 SIEVE) GREATER THAN 10%.

E. WALL BACKFILL

1. A PROTECTIVE FABRIC WILL BE USED TO INSURE AGAINST CONTAMINATION OF THE UNIT FILL.

F. DRAIN PIPE

1. DRAIN PIPE SHALL BE PERFORATED, SLOTTED PLASTIC OR EQUAL WITH A 4" MINIMUM DIAMETER, U.N.O.

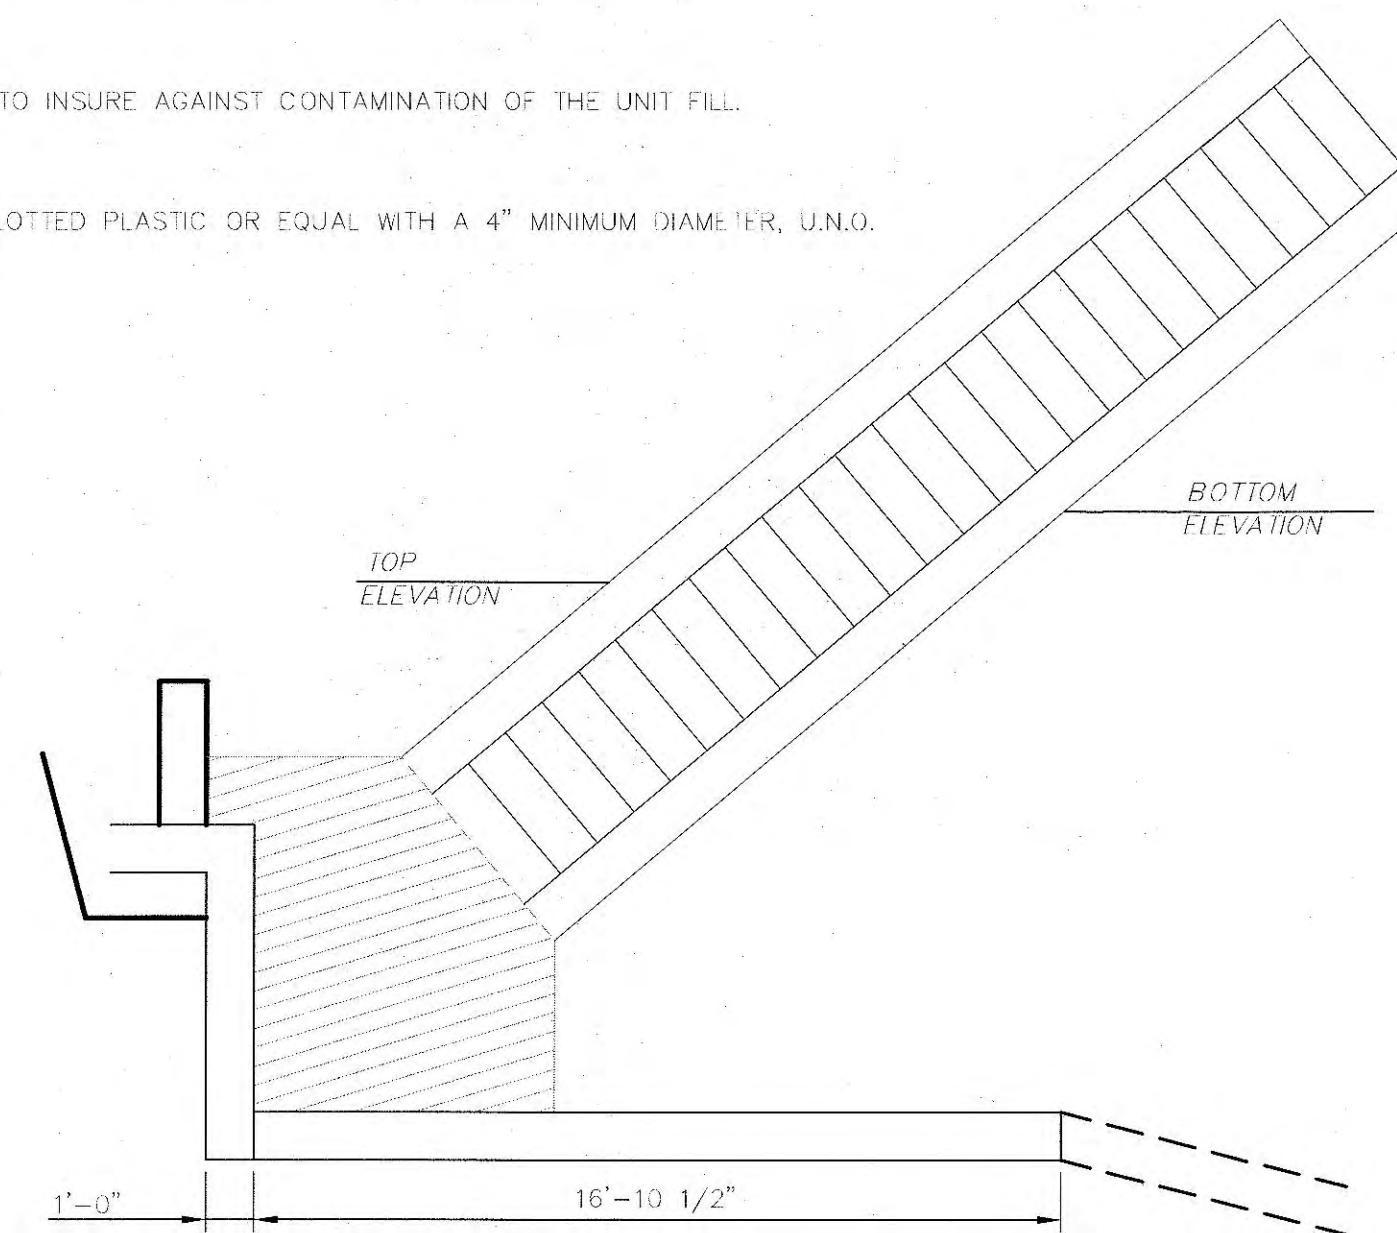

MATERIALS:

A. CONCRETE UNITS:

1. EXTERIOR DIMENSIONS FOR SHALL BE X X X
2. UNITS SHALL BE INTERLOCKED WITH PVC INSERT. THE INSERTS WILL BE INSTALLED IN THE INTENDED SLOTS OF THE UNIT. TO ACHIEVE THE DESIRED SLOPE
3. CORES SHALL BE FILLED WITH CRUSHED STONE

B. INTERLOCKING INSERTS:

1. INSERTS SHALL BE PVC.
2. CLIPS SHALL BE INSTALLED PER MANUFACTURES REQUIREMENTS.

C. BASE MATERIAL

1. AN UNREINFORCED, LEAN CONCRETE FOOTING MAY BE SUBSTITUTED FOR THE GRANULAR BASE.

D. DRAINAGE FILL

1. DRAINAGE FILL SHALL BE CRUSHED STONE. THE FILL SHALL HAVE A MAXIMUM SIZE OF 3/4" AND SHALL NOT HAVE A FINE CONTENT(PASSES #200 SIEVE) GREATER THAN 10%.

E. WALL BACKFILL

1. A PROTECTIVE FABRIC WILL BE USED TO INSURE AGAINST CONTAMINATION OF THE UNIT FILL.

F. DRAIN PIPE

1. DRAIN PIPE SHALL BE PERFORATED, SLOTTED PLASTIC OR EQUAL WITH A 4" MINIMUM DIAMETER, U.N.O.

